

Assessing the impact of hybrid heating systems in combination with off-peak EV charging on grid capacity requirements

Tamara Knittel, Colton Lowry, Peter Wild & Andrew Rowe
2025

Institute for Integrated Energy Systems (IESVic)

Energy Brief

© 2025 Knittel et al. This is an open access article distributed under the terms of the Creative Commons Attribution-NonCommercial 4.0 License:
<https://creativecommons.org/licenses/by-nc/4.0>

Original citation:

Knittel, T.; Lowry, C.; Wild, P.; Rowe, A. (2025) Assessing the impact of hybrid heating systems in combination with off-peak EV charging on grid capacity requirements. *IESVic Energy Brief*.

Downloaded from UVicSpace Research & Learning Repository
dspace.library.uvic.ca



**University
of Victoria**

Libraries

The Institute for Integrated Energy Systems (IESVic) works on strategic clean technologies, electrification and system integration, built environment, energy-economy-policy modeling, and integrated planning for water-energy-land systems. IESVic provides leadership at the University of Victoria in the study of critical energy issues, human dimensions of energy, education and training, and works closely with industry, not-for-profits, and government.

The IESVic Energy Briefs Series shares research and practice on the development of sustainable energy systems that are reliable, cost-effective and socially acceptable.

Citation: Knittel, T.; Lowry, C.; Wild, P.; Rowe, A. (2025) Assessing the impact of hybrid heating systems in combination with off-peak EV charging on grid capacity requirements. *IESVic Energy Brief*.

Published: January 29, 2025

This publication, unless otherwise indicated, is released under a Creative Commons Attribution-NonCommercial 4.0 International (CC BY-NC 4.0) License.

ISSN 2818-159X (Print)

ISSN 2818-1603 (Online)

Assessing the impact of hybrid heating systems in combination with off-peak EV charging on grid capacity requirements

Knittel, Tamara^{1*}, Lowry, Colton¹, Wild, Peter¹, Rowe, Andrew¹

¹ 2060 Group, University of Victoria, BC, Canada.

Correspondance: tamaraknittel@uvic.ca

Key messages

- Future capacity requirements are driven by electrification of heating and road transportation.
- Hybrid heating systems switching from electric to gas heating operations during cold weather events reduce electricity demand for residential space heating.
- Electric vehicle charging control can significantly limit capacity requirements of the electricity grid.

Importance: Electrification of end-use demands causes electricity load dynamics to change

In cold climate regions, electrification of building heat may have profound impacts on electricity system capacity due to a significant rise in heating demand served by electric heating technologies (Eggimann et al., 2019). If combined with electrification of road transportation, where cold temperature events affect electric vehicle (EV) charging performance (Zhao et al., 2021), there are concerns that current system capacities are insufficient to accommodate large-scale electrification of these end-uses (Chaudry et al., 2023). The temporal characteristic of demand for electrical power after electrification of building heat and road transportation makes electricity grid planning challenging. To better support the planning and management of future electricity grids, demand models with high temporal resolution are required to identify the technical requirements of adequate balancing, transmission and distribution capacity (Powell et al., 2022; Staffell et al., 2023).

In this study, we use the Road Transportation Energy Simulator by Lowry (2023) to generate electricity demand profiles for individual vehicle weight classes using two different charging strategies. The building energy demand model by Knittel et al. (2023) is used to generate electricity demand profiles for residential and commercial space and water heat with varying heating technology mixes. The projected electricity demand time series are aggregated to represent two potential futures for the province of British Columbia (BC) in 2050.

Annual population growth of 1.1% per year is assumed and the number of EVs and residential floor space are scaled accordingly. Thus, the number of EVs and residential floor space in 2050 stays constant for both scenarios. The heating technologies included in this work are baseboard heaters, high-efficiency air source heat pumps (ASHP), and hybrid heating systems. Hybrid heating systems switch from high-efficiency ASHP to gas furnace operations at a temperature switch-over point of -4°C. EVs are assumed to charge using an immediate or an off-peak charging strategy. For the immediate charging strategy, it is assumed that EVs charge once they are off-shift while EVs using the off-peak charging strategy charge over the entire off-shift period at the minimum power required to fully charge before the next vehicle shift.

Two scenarios are modeled. In the *Electric Heat Scenario*, it is assumed that 60% of medium- and heavy-duty commercial vehicles, all passenger vehicles and all light-duty commercial vehicles will be electrified by 2050 using an immediate charging strategy. 76% of residential space heat demand is assumed to be served by high-efficiency ASHPs while the remaining share is served by baseboard heaters (24%). In the *Hybrid Heat scenario*, 80% of EVs use an off-peak charging strategy while the remaining 20% use an immediate charging strategy. In this scenario, 60% of residential space heat demand is served by hybrid heating systems. The share of residential heat demand served by baseboard heaters stays constant at 24%, resulting in 17% of residential space heat demand that is served by high-efficiency ASHPs.

Results of this work show that electricity demand for residential space heat is significantly reduced in the *Hybrid Heat scenario* (Figure 1). A 60% penetration of hybrid heating systems with a temperature switch-over point of -4°C reduces peak hourly electricity demand for residential space heat by 43%, relative to fully electrified residential space heating. To serve hybrid heating

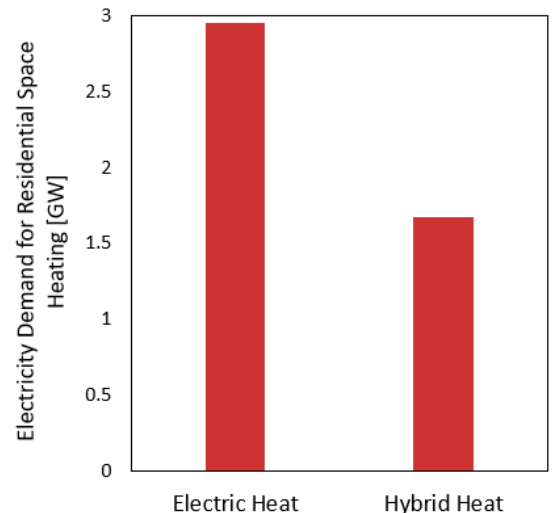


Figure 1: Electricity demand for residential space heating for two scenarios in British Columbia by 2050.

systems in gas mode, 6.8 PJ of renewable gas would be needed across the province of BC, assuming a 95% efficiency for gas furnaces. However, the reduction in electricity demand and the resulting renewable gas demand for residential space heat are dependent on the temperature switch-over point and penetration of hybrid heating systems across the province.

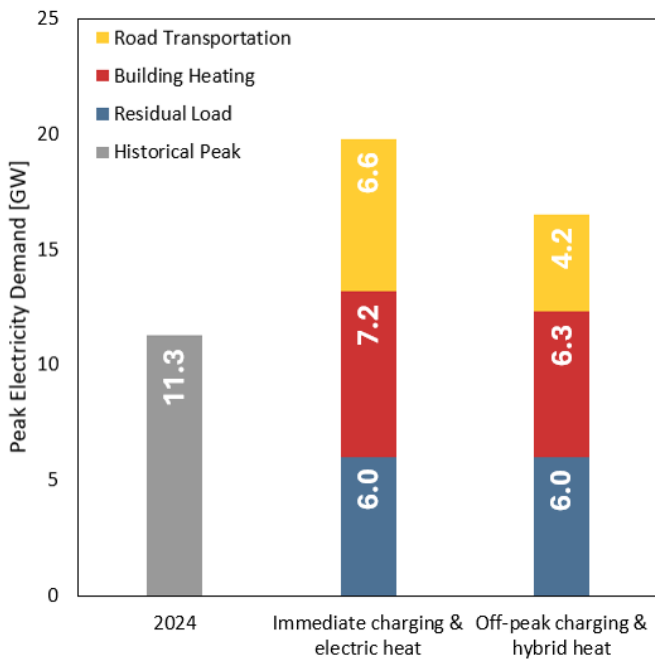


Figure 2: 2050 peak electricity demand by sector for two scenarios, relative to historical peak demand in British Columbia (BC Hydro, 2024).

For large-scale electrification of building heat and road transportation, total system peak electricity demand increases by 75%, relative to the historical peak demand in 2024 (Figure 2)¹. However, combining the use of hybrid heating systems with an off-peak charging strategy for most EVs limits the increase in peak electricity demand to approximately 46% compared to 2024.

Opportunities and barriers: Combined utility-controlled EV charging and space heating control will achieve the largest reduction in grid capacity requirements

Insufficient grid capacity poses a challenge for system operators during a few critical hours of the year. Utility-controlled EV charging or space heating control can be utilized to reduce demand during these hours (Salpakari et al., 2017). Previous work identified the potential benefit of utility-controlled EV charging in BC, showing that total system capacity can be reduced by approximately 7% (Keller et al., 2019). The opportunities of hybrid heating systems to shift peak heating loads during cold weather events away from the electrical and towards the gas grid have been previously studied; however, a ban on installation of fossil-fuel heating technologies is already in place in Vancouver, BC (Suarez & Brockman, 2024). This will prevent utilities and system operators from harnessing the grid capacity benefits of hybrid heating systems (Smillie et al., 2024). Our results show the combined benefit of EV charging and space heating control in lowering grid capacity requirements by avoiding peak

electric loads; however, the feasibility and realizable benefit of combined utility-controlled EV charging and space heating in cold climate regions such as BC are yet to be determined.

Next steps: Assessing the impact of end-use electrification across all economic sectors under future climate scenarios

The move towards electrification of building heat and road transportation in BC seems likely and additional electrification of end-use demands in the industrial sector may further increase provincial capacity requirements (Province of British Columbia, 2021). Additional analyses are needed to examine the impact of end-use electrification across all economic sectors on provincial grid capacity requirements. In addition, consideration of the impact of climate change on future ambient temperatures may exacerbate the effects of end-use electrification on future capacity requirements while simultaneously changing energy supply potential from variable renewable sources such as wind and hydroelectricity. This work uses historical temperature data to project heating and road transportation demands but it will be important to examine the impact of end-use electrification on electric grid infrastructure requirements under a range of future climate scenarios.

References

BC Hydro. (2024). *BC Hydro meets record-breaking electricity demand, helps neighbours*. https://www.bchydro.com/news/press_centre/news_releases/2024/record-breaking-electricity-demand-helps-neighbours.html

Chaudry, M., Jayasuriya, L., Hall, J. W., Jenkins, N., Eyre, N., & Eggimann, S. (2023). Simulating flexibility, variability and decentralisation with an integrated energy system model for Great Britain. *Nature*, 1–14. <https://doi.org/10.1038/s41598-023-31257-9>

Eggimann, S., Hall, J. W., & Eyre, N. (2019). A high-resolution spatio-temporal energy demand simulation to explore the potential of heating demand side management with large-scale heat pump diffusion. *Applied Energy*, 236, 997–1010. <https://doi.org/10.1016/j.apenergy.2018.12.052>

Keller, V., English, J., Fernandez, J., Wade, C., Fowler, M., Scholtysik, S., Palmer-Wilson, K., Donald, J., Robertson, B., Wild, P.,

¹ The residual load shown in Figure 2 captures as a 5-year average of historical electricity demands in the industrial and agricultural sectors and any non-heating and non-cooling related electricity demands in the building sector.

- Crawford, C., & Rowe, A. (2019). Electrification of road transportation with utility controlled charging: A case study for British Columbia with a 93% renewable electricity target. *Applied Energy*, 253(June). <https://doi.org/10.1016/j.apenergy.2019.113536>
- Knittel, T., Palmer-Wilson, K., McPherson, M., Wild, P., & Rowe, A. (2023). Heating electrification in cold climates: Invest in grid flexibility. *Applied Energy*, 356, 122333. <https://doi.org/https://doi.org/10.1016/j.apenergy.2023.122333>
- Lowry, C. (2023). *Multi-Regional Simulation of Energy Demand for Road Transport: Electrification of Passenger, Light-, Medium-, and Heavy-duty Commercial Vehicles* [University of Victoria]. https://search.library.uvic.ca/discovery/fulldisplay?docid=alma9957759335907291&context=L&vid=01VIC_INST:01UVIC&lang=en&search_scope=MyInst_and_CI&adaptor=Local Search Engine&tab=LIBALL&query=any,contains,coltonlowry&offset=0
- Powell, S., Cezar, G. V., Min, L., Azevedo, I. M. L., & Rajagopal, R. (2022). Charging infrastructure access and operation to reduce the grid impacts of deep electric vehicle adoption. *Nature Energy*, 7(10), 932–945. <https://doi.org/10.1038/s41560-022-01105-7>
- Province of British Columbia. (2021). *Roadmap to 2030*. https://www2.gov.bc.ca/assets/gov/environment/climate-change/action/cleanbc/cleanbc_roadmap_2030.pdf
- Salpakari, J., Rasku, T., Lindgren, J., & Lund, P. D. (2017). Flexibility of electric vehicles and space heating in net zero energy houses : an optimal control model with thermal dynamics and battery degradation. *Applied Energy*, 190, 800–812. <https://doi.org/10.1016/j.apenergy.2017.01.005>
- Smillie, S., Vaishnav, P., Wade, C., Jordan, K., Venkatesh, A., Sinha, A., & Apt, J. (2024). Hybrid heat pumps avoid extreme marginal abatement costs of electrifying peak heating loads in cold regions. *Environmental Research Letters*, 19(9). <https://doi.org/10.1088/1748-9326/ad6c63>
- Staffell, I., Pfenninger, S., & Johnson, N. (2023). A global model of hourly space heating and cooling demand at multiple spatial scales. *Nature Energy*. <https://doi.org/10.1038/s41560-023-01341-5>
- Suarez, R., & Brockman, C. (2024, November 28). Vancouver city council votes against natural gas in new builds. *City News*. <https://vancouver.citynews.ca/2024/11/28/vancouver-city-council-votes-against-natural-gas-reintroduction/>
- Zhao, Y., Wang, Z., Shen, Z. J. M., & Sun, F. (2021). Data-driven framework for large-scale prediction of charging energy in electric vehicles. *Applied Energy*, 282(PB), 116175. <https://doi.org/10.1016/j.apenergy.2020.116175>